


FBS Series Floor Mounted Box & Conduit Supports

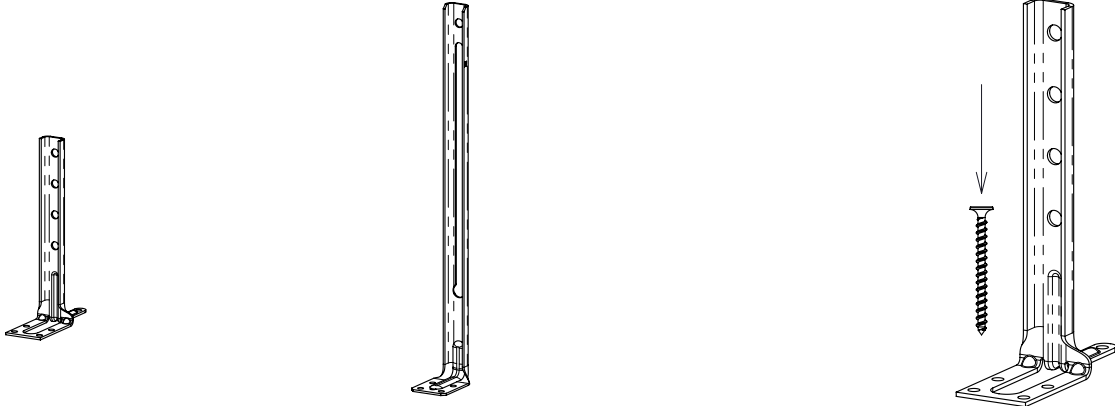

Part Number	Height
FBS4	4"
FBS6	6"



Part Number	Height
FBS12	12"
FBS16	16"
FBS18	18"

Nail or screw FBS to floor or concrete form (Nail or screw not included)

VERTICAL CONDUIT INSTALLATION

HORIZONTAL CONDUIT INSTALLATION

CADDY Bolt Close, Snap Close, or Push In Conduit Clamps can be used for additional security

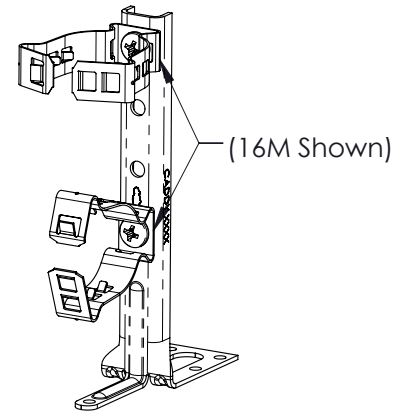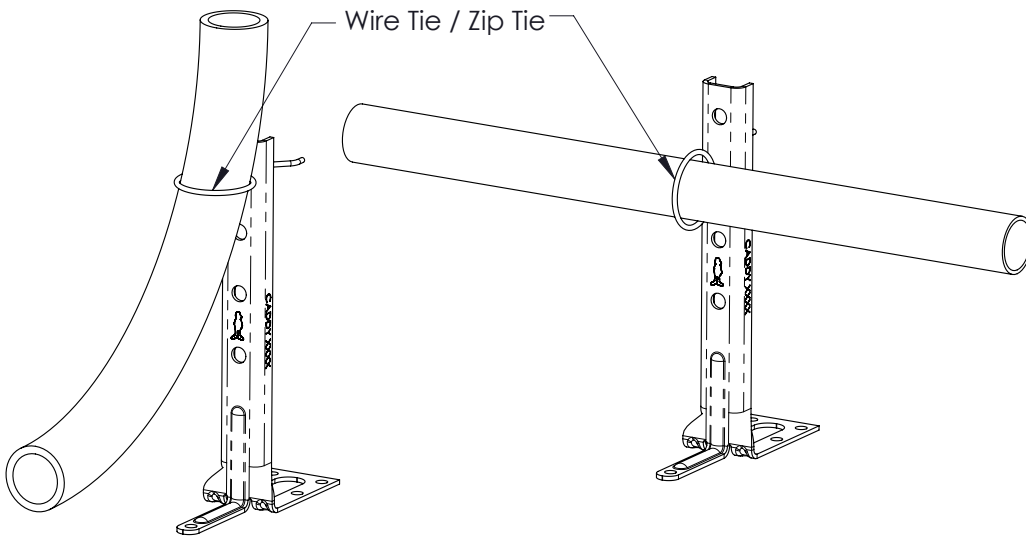

WARNING:

1. nVent products shall be installed and used only as indicated in nVent product instruction sheets and training materials. Instruction sheets are available at www.nVent.com and from your nVent customer service representative.
2. nVent products must never be used for a purpose other than the purpose for which they were designed or in a manner that exceeds specified load ratings.
3. All instructions must be completely followed to ensure proper and safe installation and performance.
4. Improper installation, misuse, misapplication or other failure to completely follow nVent's instructions and warnings may cause product malfunction, property damage, serious bodily injury and/or death, and void your warranty.
5. Products that are manufactured using spring steel components shall be used only in a non-corrosive indoor environment.
6. All pipe supports, hangers, intermediate components and structural attachments must **ONLY** be used as described herein and are **NEVER** to be used for any other purpose.

NOTE: All load ratings are for static conditions and do not account for dynamic loading such as wind, water or seismic loads, unless otherwise noted.

The customer is responsible for:

- a. Conformance to all governing codes.
- b. The integrity of structures to which the products are attached, including their capability of safely accepting the loads imposed, as evaluated by a qualified engineer.
- c. Using appropriate industry standard hardware as noted above.

SAFETY INSTRUCTIONS:

All governing codes and regulations and those required by the job site must be observed. Always use appropriate safety equipment such as eye protection, hard hat, and gloves as appropriate to the application.


nVent, nVent CADDY, nVent ERICO Cadweld, nVent ERICO Critec, nVent ERICO, nVent ERIFLEX, and nVent LENTON are owned by nVent or its global affiliates. All other trademarks are the property of their respective owners. nVent reserves the right to change specifications without prior notice.

TECHNICAL SUPPORT:
www.nVent.com


CFS189_F

1 OF 2

© 1998-2021 nVent All Rights Reserved




BOX INSTALLATION




1

Nail or screw FBS to floor or concrete form
(Nail or screw not included)



2


For Box install using 1/4-20 screw & nut
(Box, screw, & nut not included)
For Conduit install use wire ties or zip ties
Note: Box may be installed before mounting on floor



3

Adjust to desired height

Note:
For proper spacing in floor track on FBS12,
FBS16, & FBS18 place leg of box support
against edge of floor track as shown

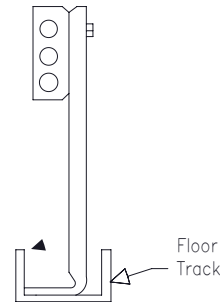

BOX APPLICATION

Used to support electrical boxes from floor or concrete forms
Slot in box support provides for 8 inches of adjustment

